



AUXILIARY SWITCH BLOCK, 80E, 4NO,  
DIN EN50011, SCREW CONNECTION,  
FOR CONTACTOR RELAYS, 4-POLE

**Auxiliary circuit:****Number of NC contacts / for auxiliary contacts**

- instantaneous switching

0

**Number of NO contacts / for auxiliary contacts**

- instantaneous switching

4

**Operating current / of the auxiliary contacts / at AC-15**

- at 230 V

A

6

**Installation/mounting/dimensions:****Type of mounting**

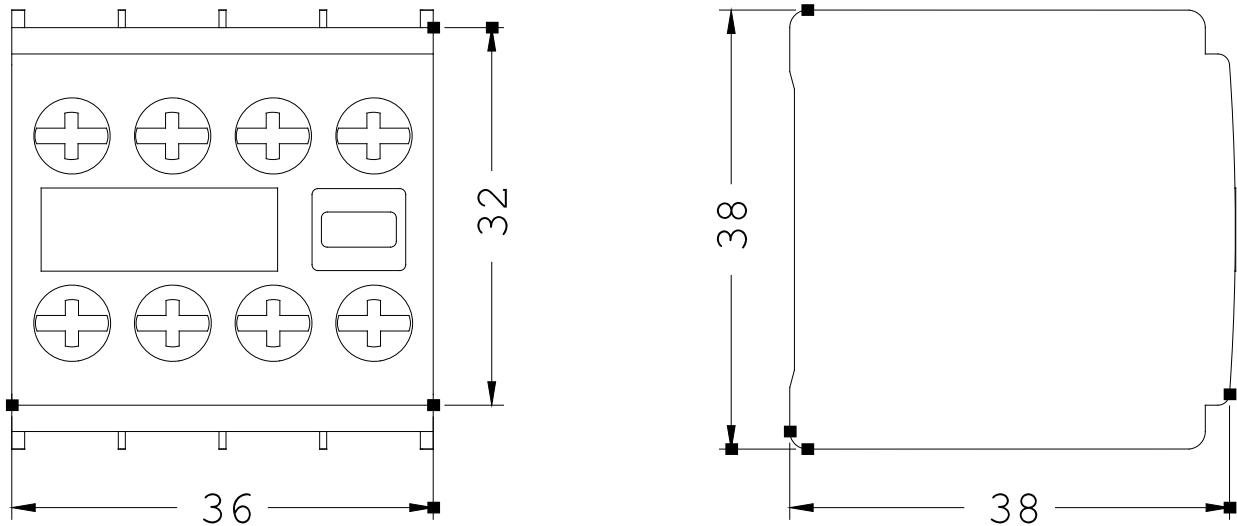
snap-on mounting

**Connections:****Design of the electrical connection**

- for auxiliary and control current circuit

screw-type terminals

**Certificates/approvals:**

**General Product Approval****Functional Safety / Safety of Machinery****Declaration of Conformity**Type Examination**Test Certificates**Special Test Certificate**Shipping Approval****other**ConfirmationotherEnvironmental Confirmations**Further information:****Information- and Downloadcenter (Catalogs, Brochures,...)**<http://www.siemens.com/industrial-controls/catalogs>**Industry Mall (Online ordering system)**<http://www.siemens.com/industrial-controls/mall>**Cax online generator:**<http://www.siemens.com/cax>**Service&Support (Manuals, Certificates, Characteristics, FAQs,...)**<http://support.automation.siemens.com/WW/view/en/3RH1911-1GA40/all>**Image database (product images, 2D dimension drawings, 3D models, device circuit diagrams, ...)**[http://www.automation.siemens.com/bilddb/cax\\_en.aspx?mlfb=3RH1911-1GA40](http://www.automation.siemens.com/bilddb/cax_en.aspx?mlfb=3RH1911-1GA40)**last change:**

Jun 16, 2012